

Tc max=105°C  
Risk group(EN 62471:2008)=1

General safety instructions: information on restrictions related to use of the light fixtures (class, IP, etc), can be found both on the fixture label and on our website at [www.rovasi.com](http://www.rovasi.com).

The wiring schematics can be found on page 2 of the document.

**ELECTRONIC EQUIPMENT:**

**S:** On/Off.  
**D:** DALI/DSI/switchDIM/corridorFUNCTION.  
**B:** Bluetooth Casambi.

**ACCESSORIES**

43  
260  
120  
175  
159

17W / 500mA

907MOV.1-T869  
907MOV.1-T870  
907MOV.1-T871  
907MOV.1-T872  
907MOV.1-T873  
907MOV.1-T874

3

3

4

4

5

L1  
L2  
L3

M6x12 X2

M3x6 X2

LED technology and performance data are constantly changing. Current details should therefore be checked with ROVASI in order to ensure that its still the mostup to date reference. Updated data will be supplied on request. [30.04.2021]



**Installation instructions. Mains supply wires**

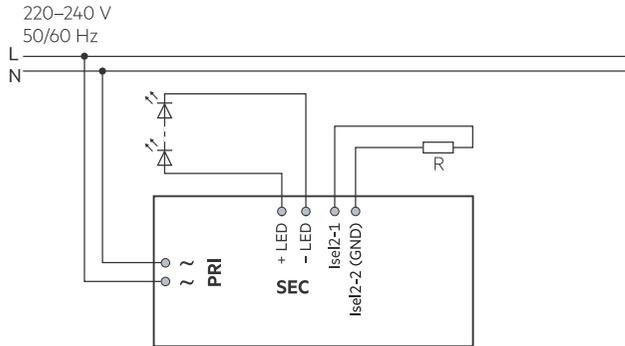
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0,2-0,5mm<sup>2</sup>.
- Strip 8,5-9,5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

**Wiring guidelines**


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



Release of the wiring  
Press down the "push button"  
and remove the cable from front.

Wiring diagram **S: On/Off**

Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm

**Installation instructions. Mains supply wires**

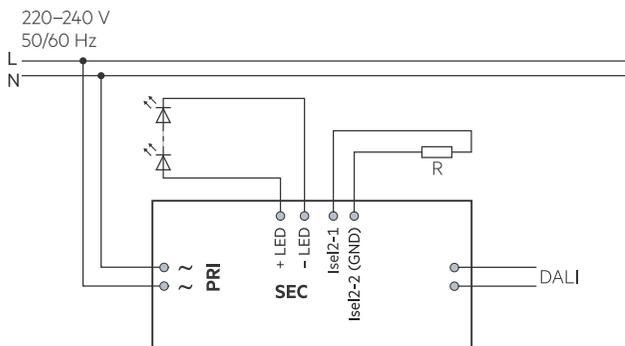
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0,2-0,5mm<sup>2</sup>.
- Strip 8,5-9,5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

**Wiring guidelines**


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



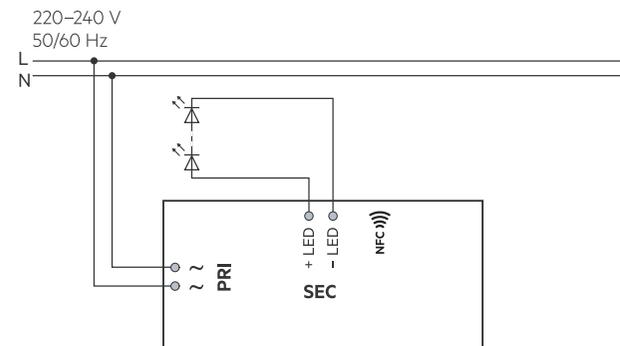
Release of the wiring  
Press down the "push button"  
and remove the cable from front.

Wiring diagram **D: DALI/DSI/SwitchDIM/corridorFUNCTION**


Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm

Wiring diagram **B: basicDIM Wireless**

Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm