

	<p>Tc max=105°C Risk group(EN 62471:2008)=1</p>	<p>General safety instructions: information on restrictions related to use of the light fixtures (class, IP, etc), can be found both on the fixture label and on our website at <a href="http://www.rovasi.com">www.rovasi.com</a>.</p> <p>The wiring schematics can be found on page 2 of the document.</p> <p><b>ELECTRONIC EQUIPMENT:</b></p> <p><b>S:</b> On/Off. <b>D:</b> DALI/DSI/switchDIM/corridorFUNCTION. <b>B:</b> Bluetooth Casambi.</p> <p><b>ACCESSORIES</b></p>	<p>30W / 900mA</p> <p>913MOV.1-T1110 913MOV.1-T1111 913MOV.1-T1112 913MOV.1-T1113 913MOV.1-T1114 913MOV.1-T1115</p>
--	---	---	---

--	--	--	--

LED technology and performance data are constantly changing. Current details should therefore be checked with ROVASI in order to ensure that its still the mostup to date reference. Updated data will be supplied on request. [30.04.2021]

**Installation instructions. Mains supply wires**

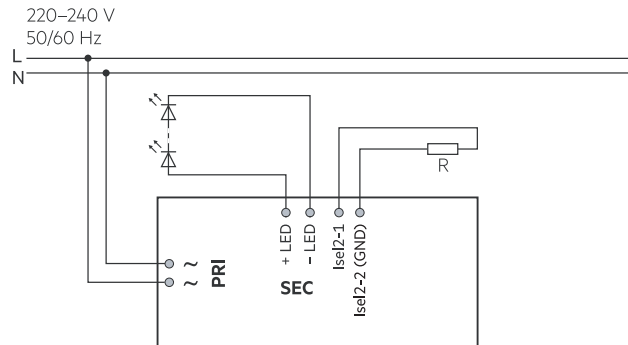
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0.2-0.5mm<sup>2</sup>.
- Strip 8.5-9.5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

**Wiring guidelines**


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



Release of the wiring  
Press down the "push button"  
and remove the cable from front.

**Wiring diagram S: On/Off**

Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm

**Installation instructions. Mains supply wires**

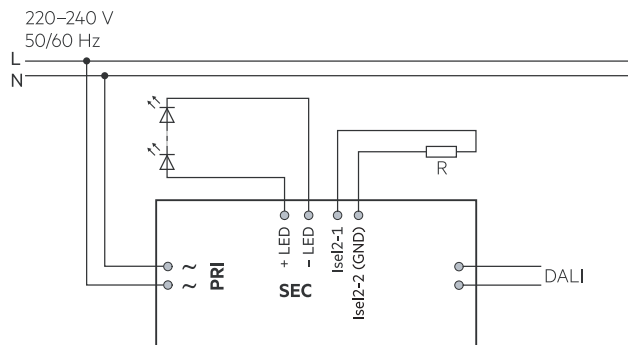
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0.2-0.5mm<sup>2</sup>.
- Strip 8.5-9.5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

**Wiring guidelines**


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



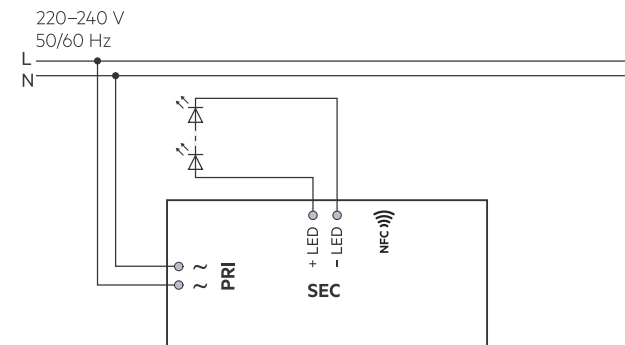
Release of the wiring  
Press down the "push button"  
and remove the cable from front.

**Wiring diagram D: DALI/DSI/SwitchDIM/corridorFUNCTION**


Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm

**Wiring diagram B: basicDIM Wireless**

Input / Output terminal

0,2 – 0,5mm<sup>2</sup>

8.5– 9.5mm