

	<p>Tc max=105°C Risk group(EN 62471:2008)=1</p>	<p>General safety instructions: information on restrictions related to use of the light fixtures (class, IP, etc), can be found both on the fixture label and on our website at www.rovasi.com.</p> <p>The wiring schematics can be found on page 2 of the document.</p> <p>ELECTRONIC EQUIPMENT:</p> <p>S: On/Off. D: DALI/DSI/switchDIM/corridorFUNCTION. B: Bluetooth Casambi.</p>	<p>23W / 700mA</p> <p>911MOV.1-T881 911MOV.1-T882 911MOV.1-T883 911MOV.1-T884 911MOV.1-T885 911MOV.1-T886</p>
		<p>ACCESSORIES</p>	

--	--	--	--

LED technology and performance data are constantly changing. Current details should therefore be checked with ROVASI in order to ensure that its still the mostup to date reference. Updated data will be supplied on request. [30.04.2021]

Installation instructions. Mains supply wires

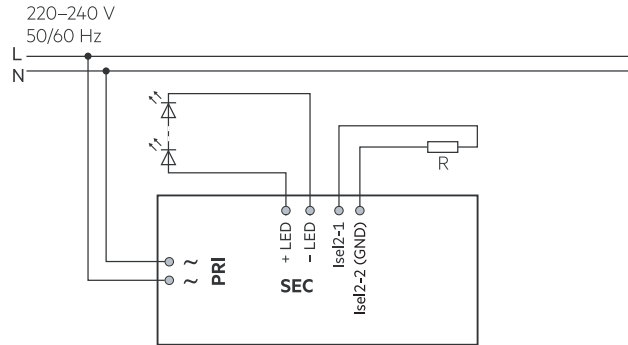
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0.2-0.5mm².
- Strip 8.5-9.5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

Wiring guidelines


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



Release of the wiring
Press down the "push button"
and remove the cable from front.

Wiring diagram S: On/Off

Input / Output terminal

0,2 – 0,5mm²

8.5– 9.5mm

Installation instructions. Mains supply wires

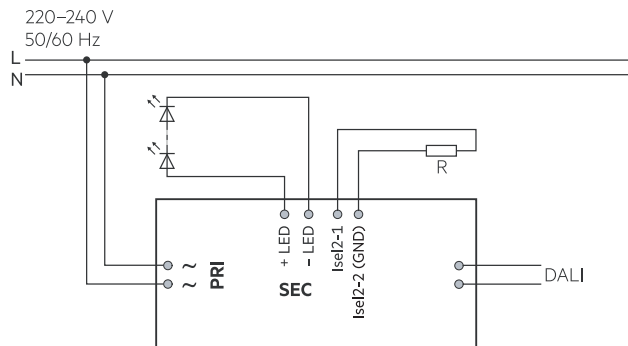
- Wiring type and cross section
- The wiring can be stranded wires with ferrules or solid with a cross section of 0.2-0.5mm².
- Strip 8.5-9.5mm of insulation from the cables to ensure perfect operation of the push-wire terminals.
- Use one wire for each terminal connector only.
- Use each strain relief channel for one cable only.
- Installation may require advice from a qualified person.
- Single lights apt for inner use (no outer)

Wiring guidelines


- All connections must be kept as short as possible to ensure good EMI.
- Max. length of output wires is 200mm. Secondary switching is not permitted.
- Incorrect wiring can damage LED modules.



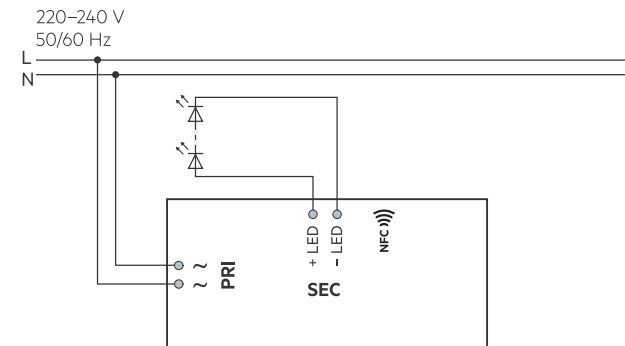
Release of the wiring
Press down the "push button"
and remove the cable from front.

Wiring diagram D: DALI/DSI/SwitchDIM/corridorFUNCTION


Input / Output terminal

0,2 – 0,5mm²

8.5– 9.5mm

Wiring diagram B: basicDIM Wireless

Input / Output terminal

0,2 – 0,5mm²

8.5– 9.5mm